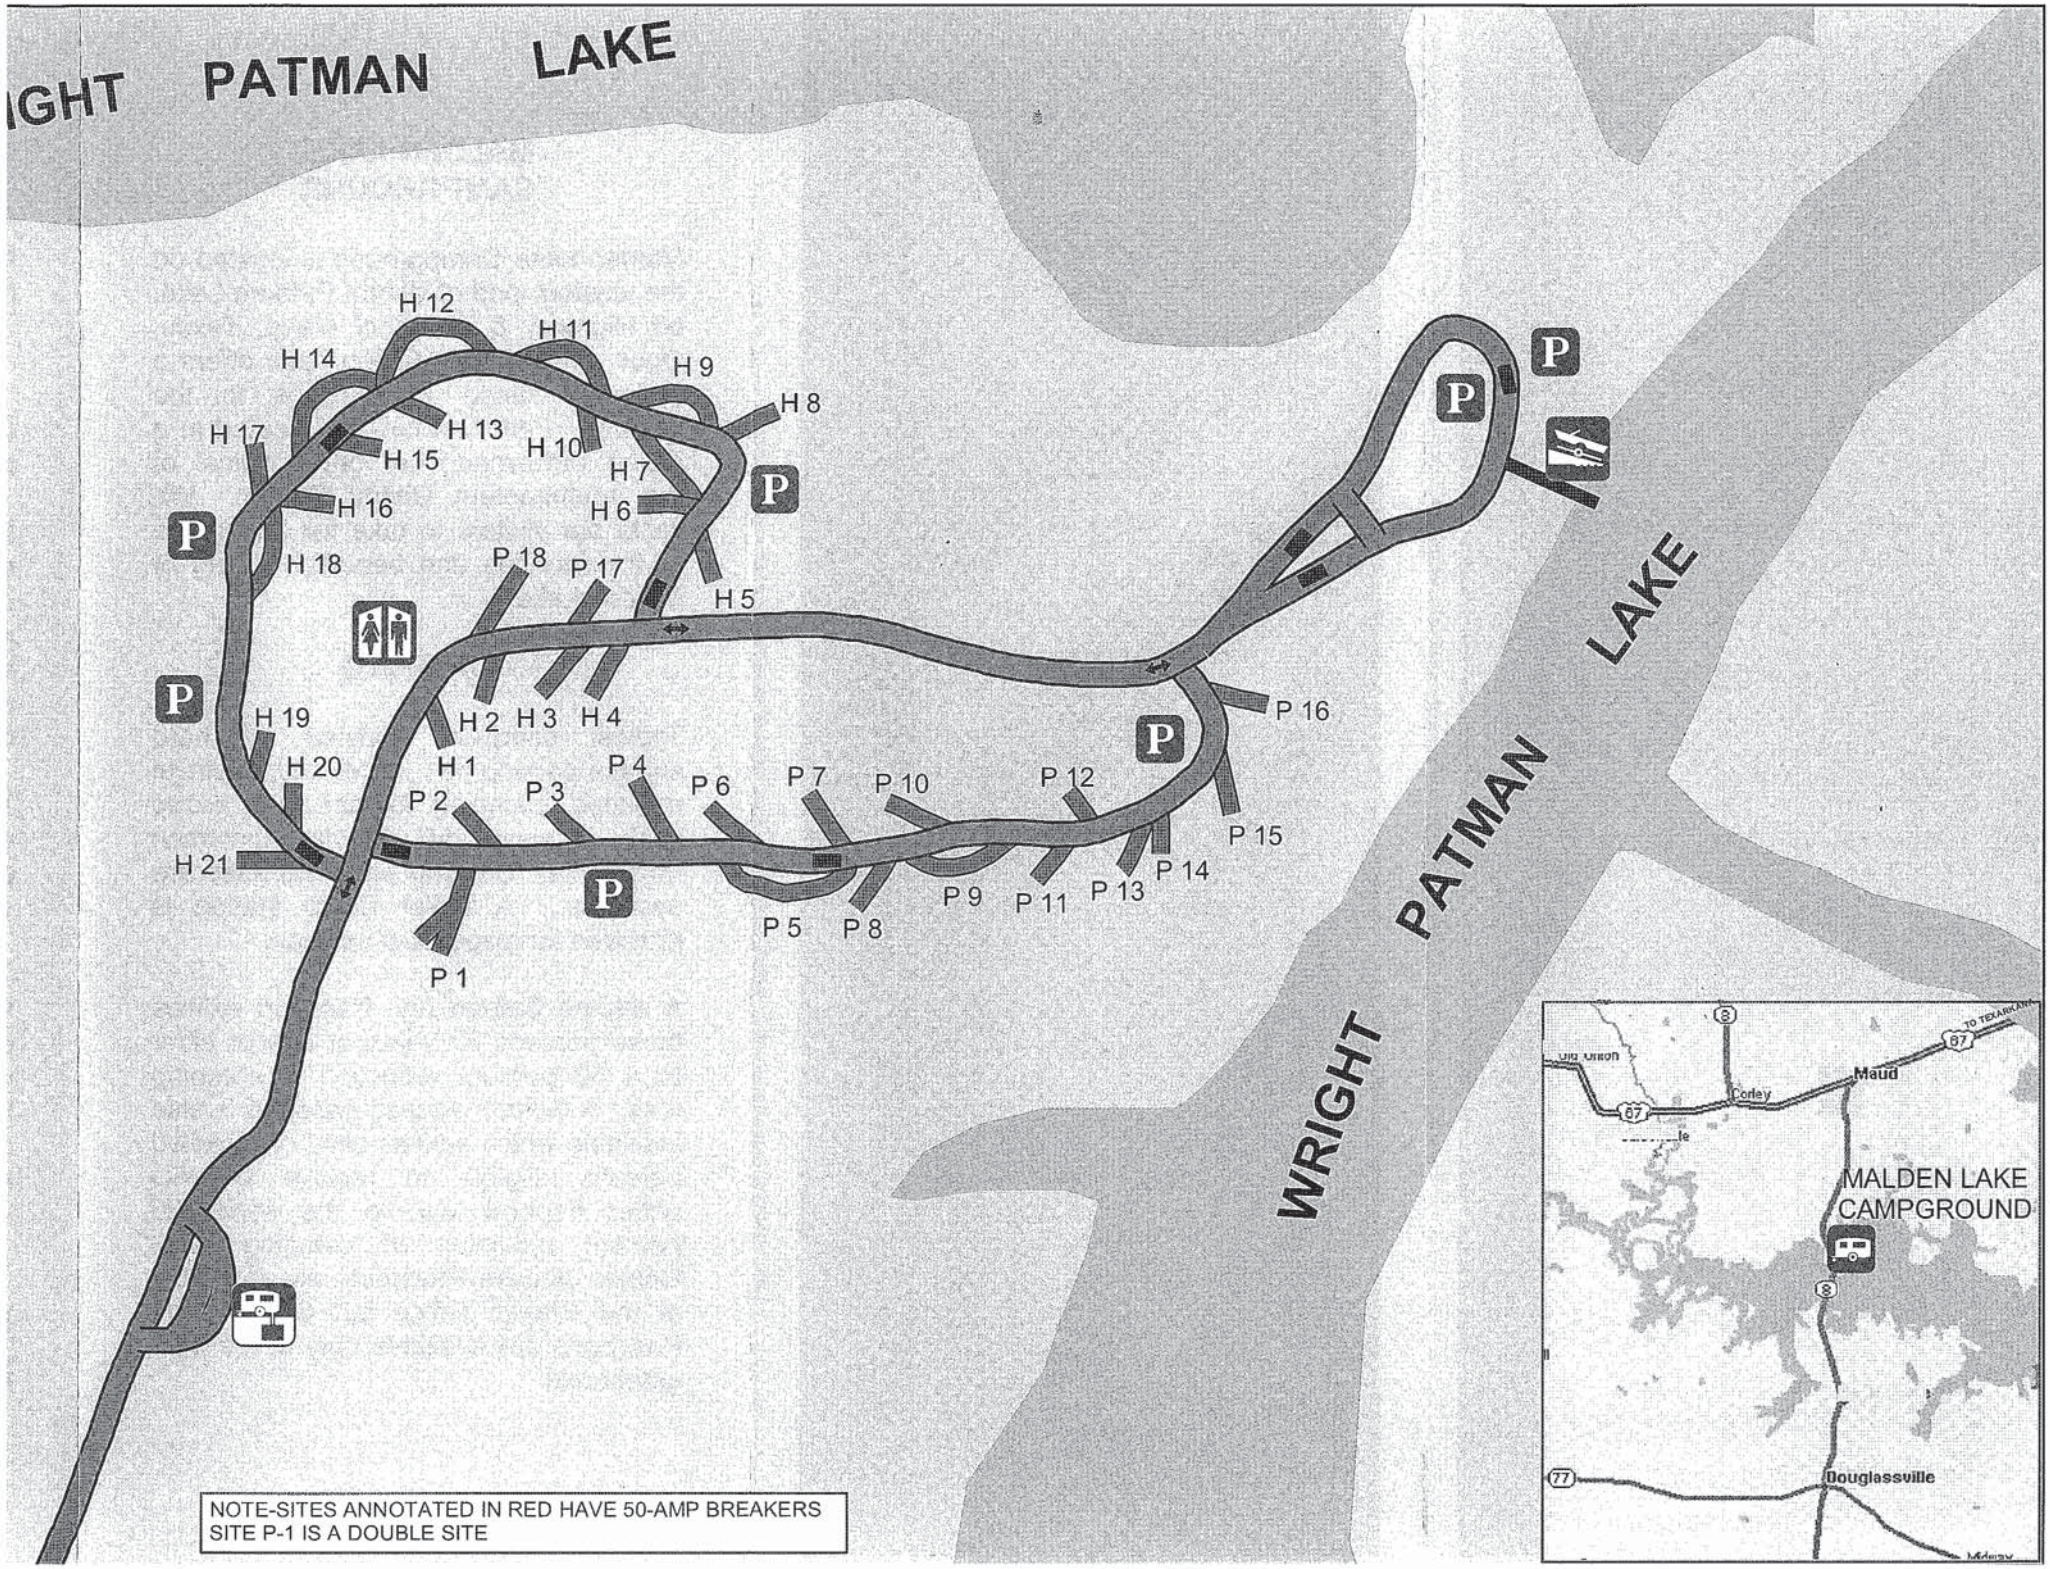

NOTE-SITES ANNOTATED IN RED HAVE 50-AMP BREAKERS
SITE P-1 IS A DOUBLE SITE